
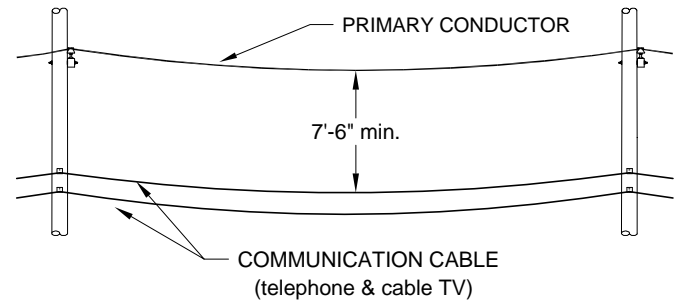


CAUTION:
 Communication cable guying (telephone and cable television) shall be secured on an anchor owned by them. Guying to an anchor owned by the electric company is not allowed.

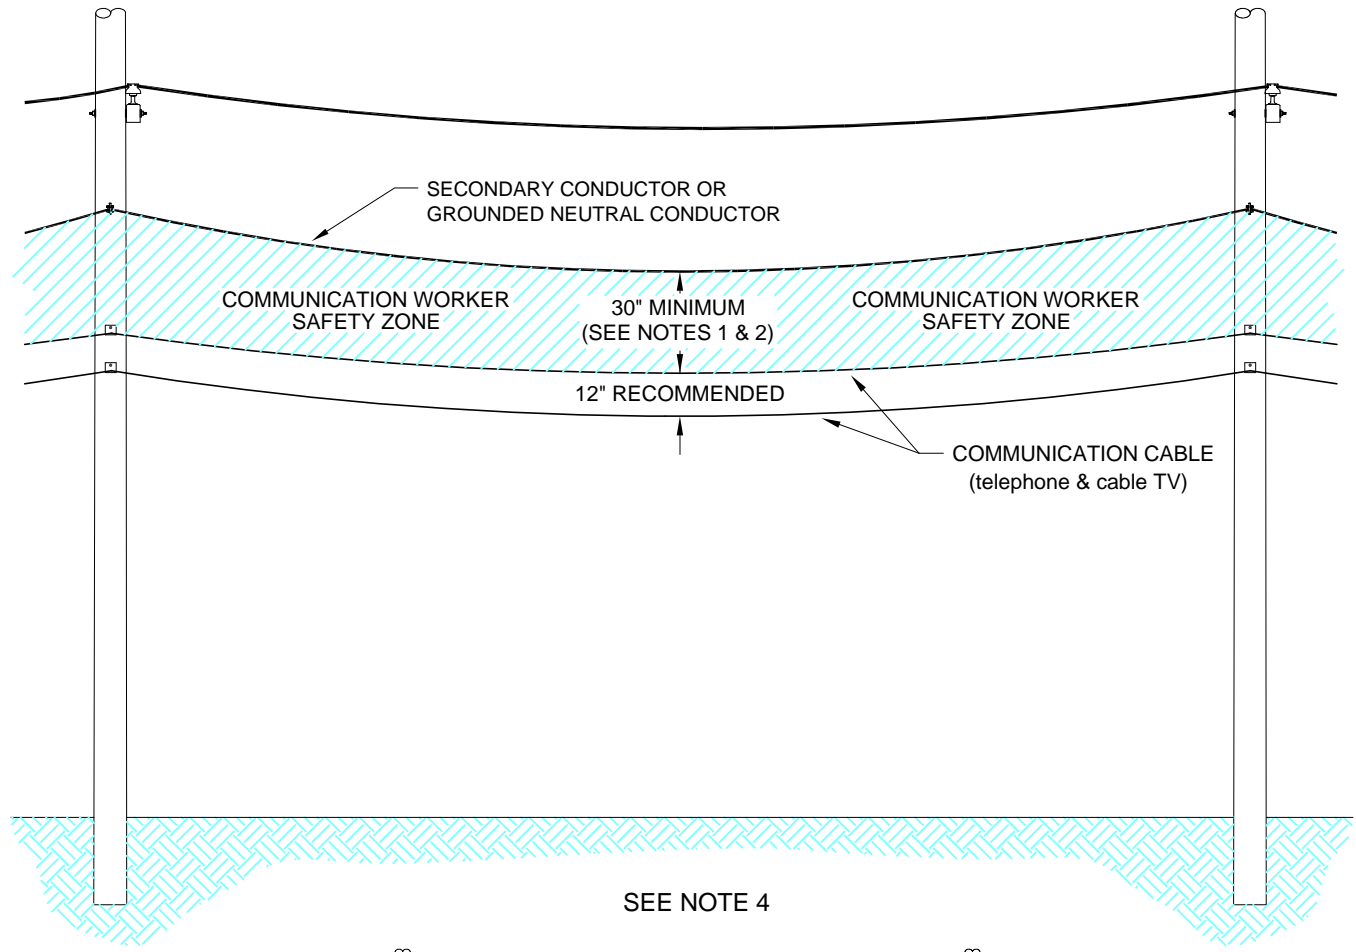

NOTES:

1. See N.E.S.C. 235C2b
2. Where the lowest level electric conductor is greater than 8.7kV phase to ground, increased clearances are required. Refer to N.E.S.C. Tables 235-5, and 238-1.
3. See drawings DAS03121 & DAS03131 for pole attachment clearances on poles that have secondary conductors.
4. Minimum midspan clearances is 7'-6" for poles with only primary conductors.
5. See drawing DAS03151 for pole attachment clearances on poles that have only primary conductors.

ENTERGY SERVICES, INC.			
COMMUNICATION CABLE CLEARANCES AND REQUIREMENTS MIDSPAN			
APPROVED BY:	JRH	DATE:	5/28/02
CHECKED BY:	RHO	SCALE:	NONE
DRAWN BY:	DAT	CEA NO.:	00000
		No. DAS03141	
PLOT 1=32		SH. 1 OF 1	

NO.	DATE:	REVISION	BY:	APPR:
-----	-------	----------	-----	-------