


**Notes:**

1. All diagrams on this drawing show connections when the switch is installed on the right side (see Right Side below) of the meter socket. If the switch is installed on the left side of the meter socket you will need to mirror this diagram (see Left Side below).
2. All sockets, except residential single phase less than 320 Amps, shall have a manual mechanical gang operated bypass switch.
3. Load and supply wires shall not cross in the meter socket.

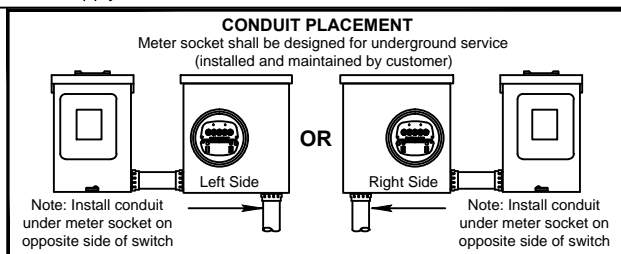

ENERGY SERVICES, INC.

**WIRING DIAGRAM CONNECTIONS FOR UNDERGROUND SELF CONTAINED METERS**

APPROVED BY: JRH	DATE: 01/10/2013
CHECKED BY: JED	SCALE: NONE
DRAWN BY: krich95	

No. D9-3

PLOT 1=1 SH. 2 OF 2

2	06/15/17	Updated Meter Enclosure Diagram	ERG
1	01/13	REVISION OF DRAWING SS11.8-2	JED
NO.	DATE:	REVISION	BY: APPR: